


FLOOR/ROOF
ASSEMBLY PER UL
LISTING

SEE UL LISTINGS FOR
SEALANT OPTIONS

FASTENERS AT 3" O.C.
MAX (LOCATED FASTENERS
TO AVOID ANCHORING TO
C-T STUDS)

OUTER/OVERLAPPING
GYPSUM WALLBOARD
STRIPS

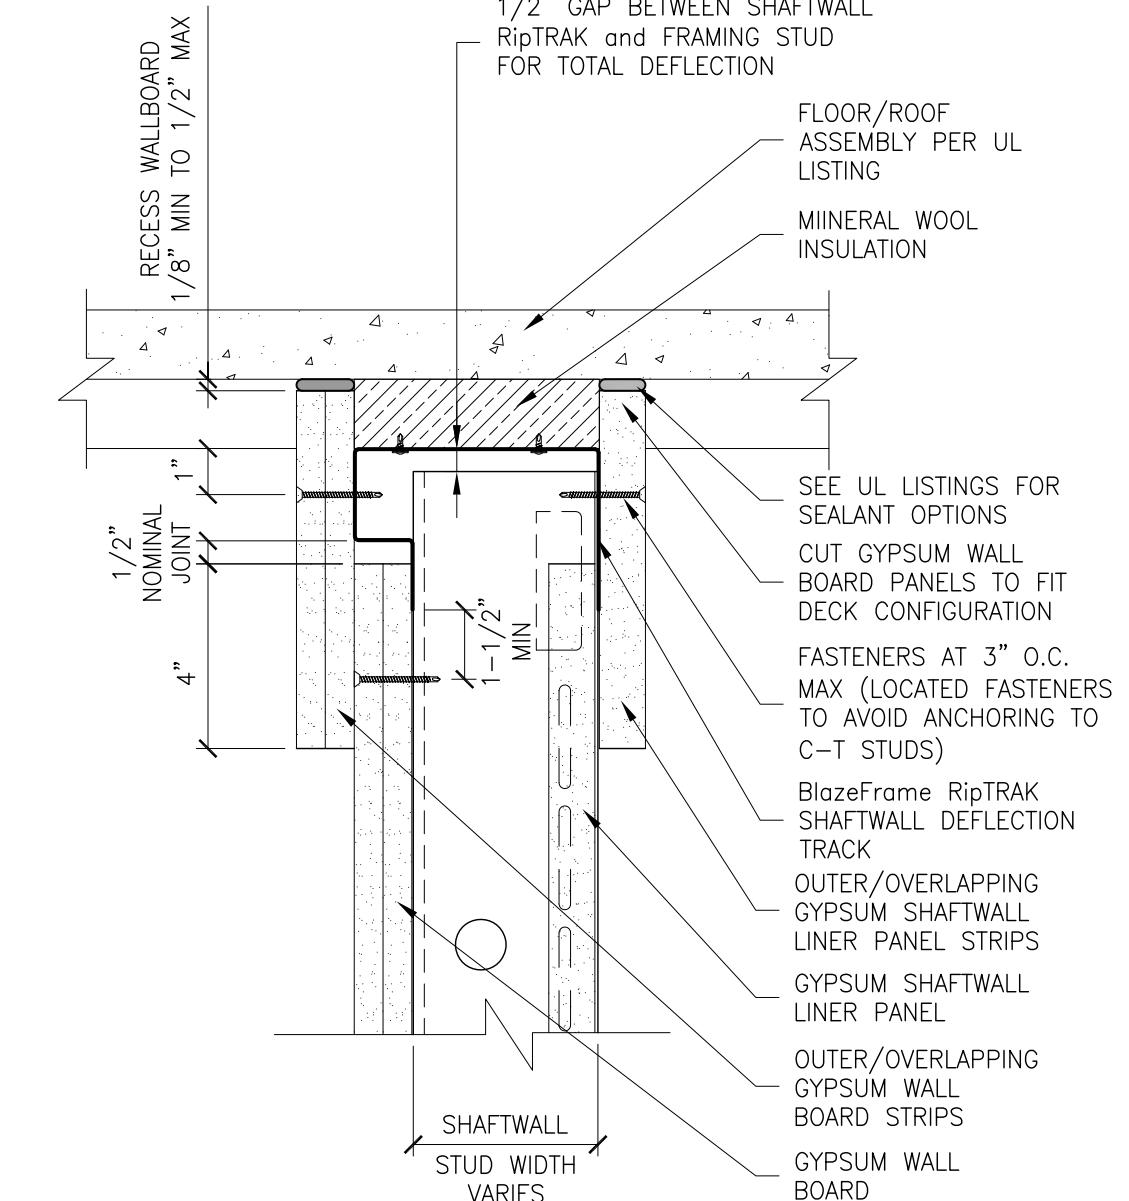

1/2" GAP BETWEEN SHAFTWALL
RipTRAK and FRAMING STUD
FOR TOTAL DEFLECTION

FLOOR/ROOF
ASSEMBLY PER UL
LISTING

MINERAL WOOL
INSULATION

SEE UL LISTINGS FOR
SEALANT OPTIONS

CUT GYPSUM WALL
BOARD PANELS TO FIT
DECK CONFIGURATION

FASTENERS AT 3" O.C.
MAX (LOCATED FASTENERS
TO AVOID ANCHORING TO
C-T STUDS)

BlazeFrame RipTRAK
SHAFTWALL DEFLECTION
TRACK

OUTER/OVERLAPPING
GYPSUM SHAFTWALL
LINER PANEL STRIPS

GYPSUM SHAFTWALL
LINER PANEL

OUTER/OVERLAPPING
GYPSUM WALL
BOARD STRIPS

GYPSUM WALL
BOARD

SECTION A-A

HEAD OF WALL DETAIL SWRT2-1-UD-1

UL LISTED FLOOR/ROOF ASSEMBLY W/ UNPROTECTED DECK (UD) - MINERAL WOOL FILL

UL DESIGN HW-D-0908
(2 HR WITH 1/2" NOMINAL JOINT)



Engineering Services: (877) 832-3206

Technical Services: (888) 437-3244

The CAD detail library is intended to provide general framing details only and does not replace the judgments and designs of a qualified architect and/or engineer. The details are provided as a starting tool to assist the user in creating and detailing cold-formed steel framing construction details. Each detail including accompanying text must be thoroughly evaluated and approved by a qualified architect or engineer. | Find over 500 CAD details at cad.clarkdietrich.com | © Copyright 2020 ClarkDietrich